

Desigo™ Room Automation

## Compact actuating room automation stations, BACnet/IP, AC 24 V (Actuating DXR)

DXR1.E10PL-112, DXR1.E10PL-113



**Combination of room automation station and actuator for buildings with increasing demand on functionality and flexibility in Room Automation, VAV and FPB applications.**

- Compact, configurable room automation station in combination with actuator for HVAC
- BACnet IP communications (BTL certified)
- 2-port Ethernet switch
- USB interface
- KNX PL-Link bus to connect sensors, actuators, and operator units (including bus power)
- Operating voltage AC 24 V
- Built-in 10 Nm actuator
- Internal 0...500 Pa differential pressure sensor
- Plug-in terminal blocks

## Features

### Configurable

The DXR1.. automation stations provide the infrastructure for systems and application-specific functions which can be configured.

### Compact series

The compact build allows direct mounting on the damper shaft. It is designed for VAV and FPB.

### Plug-in terminal blocks

Plug-in terminal blocks for easy exchange of room automation stations.

### Integrated actuator

The actuator gear base is integrated into the housing of the actuating DXR. It supports dampers with up to 10 Nm torque.

## Use

Desigo Room Automation offers the highest level of flexibility for energy-optimized solutions while satisfying requirements for temperature control, ventilation and comfort using standard tools and established workflows.

### Preinstalled applications

- Variable (VAV), Fan Powered Box (FPB) and constant air volume flow
  - With staged and modulating electric heating
  - With modulating hot water / chilled water with room or supply air temperature control
- Radiant ceiling: cooling, cooling and heating (2-pipe), or cooling / heating (4-pipe), heating
- Radiator: hot water, electric stepped or modulated controlled

### Application options

- Separate temperature and air volume flow setpoints for all 4 operating modes
- Separate minimum and maximum cooling and heating flow setpoints
- Single-stage, multiple-stage or variable fan control (FPB / DXR1.E10PL-113)
- Chilled water and hot water valve
- Extract air volume flow control

## Functions

The selected application and its parameters as well as input and output configuration determine the room automation station's functionality.

A detailed description of functionality is available in the ABT (Automation Building Tool) online help.

### Communication

- 2-port Ethernet switch for cost-effective cabling via line topology
- USB connection for service, commissioning and firmware download
- KNX PL-Link communication with room operator units, sensors and actuators


## LED indication

LED	Color	Activity	Function
Run	Green	Steady ON	Device is ready for operation
		Steady OFF	Device is not powered
		Regular flashing	Start-up or the program is stopped
	Red	Steady OFF	OK
		Steady ON	Program error Communications error (KNX PL-Link) Hardware fault
		Rapid flashing	Wrong or corrupt software No application loaded
		Blinking per wink command	Physical device identification

## Service button (SVC)

Physical identification on the network.

## Technical / Mechanical design

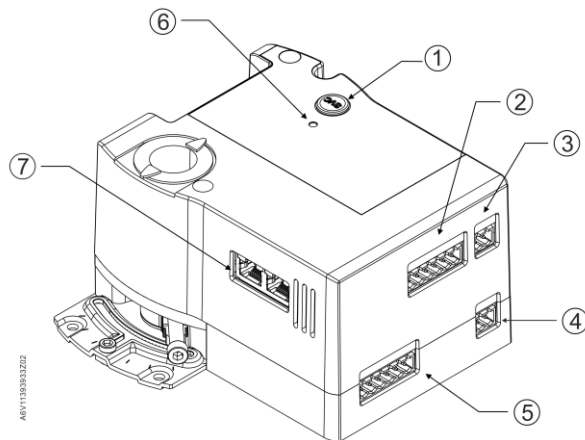

1	Service button (SVC) for sending device identification	2	2 UIs (universal input), 1 AO (analog output), 1 DI (digital input)
3	Power supply	4	KNX interface
5	DOs (digital Triac output)	6	Status information LED (bi-color)
7	2-port Ethernet switch		

## Housing

The housing consists essentially of flame retardant, non-brominated plastic.

## Type summary

Product No.	Stock No.	Inputs	Outputs	Description	Quantity
DXR1.E10PL-112	S55499-D458	2 universal inputs, 1 digital input	4 digital outputs, 1 analog output	VAV application	Single package / multiple package (10)
DXR1.E10PL-113	S55499-D459			FPB application	Single package / multiple package (10)

### Ordering

When ordering, indicate product number, stock number and description.

## Equipment combinations

### Remote sensors and room operator units

Type of unit	Product No.	Stock No.	Temperature	Humidity	Air quality indication	Datasheet*
Sensors	AQR2570N + AQR2532NNW	S55720-S203	√	-	-	CE1N1411en
		S55720-S136				
	AQR2570N + AQR2535NNW	S55720-S203	√	√		CE1N1411en
		S55720-S141				
	AQR2576N+ AQR2530NNW	S55720-S207	-	-	-	CE1N1411en
		S55720-S137				
	AQR2576N+ AQR2532NNW	S55720-S207	√	-	-	CE1N1411en
		S55720-S136				
	AQR2576N+ AQR2535NNW	S55720-S207	√	√	√	CE1N1411en
		S55720-S141				
QMX3.P30	S55624-H103	√	-	-	CM2N1602en	
QMX3.P40	S55624-H116	√	√	-	CM2N1602en	
QMX3.P70	S55624-H104	√	√	√	CM2N1602en	
UP 258D12 (presence detector)	5WG1258- 2DB12	-	-	-	A6V10489489	
Room operator units	QMX2.P33	S55624-H118	√			A6V11207411
	QMX3.P34	S55624-H105	√			CM2N1602en
	QMX2.P43	S55624-H117	√	√		A6V11207411
	QMX3.P74	S55624-H106	√	√	√	CM2N1602en

\* The documents can be downloaded from <http://siemens.com/bt/download> by specifying the Datasheet number as shown in the above table.

### Controller and actuators

Type of unit	Product no.	Stock no.	Datasheet*
VAV compact controller	GDB181.1E/KN	S55499-D134	CE1N3547en
	GLB181.1E/KN	S55499-D135	CE1N3547en
Ball valve actuator	GDB111.9E/KN	S55499-D203	A6V10631832
	GLB111.9E/KN	S55499-D207	A6V10631832

\* The documents can be downloaded from <http://siemens.com/bt/download> by specifying the product number as shown in the above table.


Topic	Title	Document ID:
Installation, cable length, topology	Desigo Room Automation installation guide	CM111043
Engineering and commissioning	ABT online help	N/A
Installation instruction	Mounting instructions	A6V11393918
Commissioning	Quick guide	A6V11526405
Product environmental declaration		A6V11805930
EU declarations (CE)		A6V11791489

Documents such as environmental declarations, CE declarations, etc., can be downloaded at the following Internet address:

<http://siemens.com/bt/download>

Notes

Security

	<p><b>⚠ CAUTION</b></p>
	<p><b>National safety regulations</b>                      Failure to comply with national safety regulations may result in personal injury and property damage.</p> <ul style="list-style-type: none"> <li>• Observe national provisions and comply with the appropriate safety regulations.</li> <li>• Use only properly trained technicians for mounting, commissioning and servicing.</li> </ul>

Engineering

**Identification**


Each device has a unique serial number to ensure efficient commissioning. It is provided on the adhesive barcode reader. The serial number can be read directly into the engineering tool using a barcode reader.

**Wiring**

Wiring must be sufficiently insulated to the available rated voltage. Sizing and fusing of the wiring depend on the connected load.

## Mounting

The automation station is mounted directly on a damper shaft.

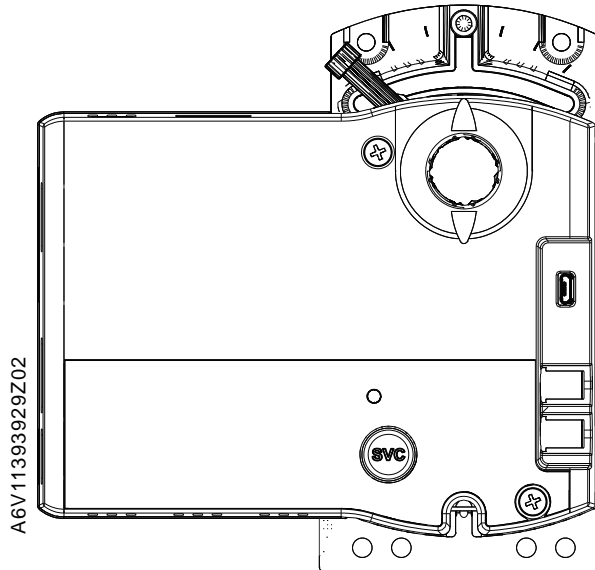

See the mounting instructions (document ID: A6V11393918) for detailed information.

## Installation

Applies to devices with supply output (AC 24 V or mains voltage) such as Triac output or output to supply a field device.



### ⚠ WARNING

#### No internal line protection for supply lines to external consumers

Risk of fire and injury due to short-circuits

- Adapt the line diameters as per local regulations to the rated value of the installed fuse.

## Maintenance

The automation station is maintenance-free.

## Disposal



The device is considered an electronic device for disposal in accordance with the European Guidelines and may not be disposed of as domestic garbage.

- Dispose of the device through channels provided for this purpose.
- Comply with all local and currently applicable laws and regulations.

## Warranty

Technical data on specific applications are valid only together with Siemens products listed under "Equipment combinations". Siemens rejects any and all warranties in the event that third-party products are used.

## Technical data

### Power data

Power supply	
Operating voltage (SELV/PELV)	AC 24 V +/-20%
Frequency	50 or 60 Hz
Power consumption	12 VA max.

Transformer requirements and recommended voltages	
Type	Class 2, AC 24 V, 50 / 60 Hz, SELV, PELV

### Functional data

Functional data	
Nominal torque	10 Nm
Nominal rotary angle	90°
Maximum rotary angle	95° ± 2°
Runtime for 90° rotary angle	150 s
Shaft size	8...16 mm, round 8...10 mm, round (with centering insert) 6...12.8 mm square
Minimum shaft length	20 mm

### Universal inputs

Analog inputs: DC 0...10 V	
Operating range	0...10 V
Resolution	10 mV

Analog inputs: sensors			
Type	Measuring range	Accuracy	Resolution
LG / DIN-Ni 1000	0...50 °C	±0.5 K at 25 °C	0.1 K at 25 °C
P11K, 375 / 385			
NTC10K / NTC100K			

Digital inputs	
0/1 digital signal (binary)	For potential-free contacts
Sampling voltage/current	DC 15 V, 7 mA
Contact resistance	Max. 200 Ω (closed) Min. 50 kΩ (open)
Delay	10 ms
Pulse frequency	Max. 20 Hz

### Outputs

Analog output	
Control range	0...10 V
Resolution	5 mV
Output current	Max. 1 mA

Triac outputs	
Number of channels	4
Type	High side The Triac closes the contact to AC 24 V
Current rating	0.5 A max. per channel
Voltage rating	AC 24 V +/-20%
Max. load	12 VA per channel

## Pressure sensor

Pressure sensor	
Measurement range	0...500 Pa
Sample rate	≤ 500 ms
Overload range	0...100 kPa
Measuring range accuracy	3%
Zero point accuracy	0.2 Pa
Resolution	12 Bit

## Connections

Interfaces	
Ethernet	Plugs: dual RJ45, 10M/100M fast Ethernet Interface type: IEEE 802.3 compliance Cable type: 100 M STP CAT 5
USB (2.0)	Type Micro B
KNX PL-Link	Terminal: 5.08 mm, 2 pin DPSU: 50 mA, non-standard DPSU

KNX PL-Link: Consider maximum bus load and different device types (two devices of the same type are not supported).

Wiring connections	
Wiring lengths for signals	KNX PL-Link: 80 m with internal bus power Signal lines: 80 m For analog inputs: 30 m

## Conformity

Ambient conditions and protection classification	
Classification per IEC/EN 60730	Type 1
Function of automatic control devices	2
Pollution degree	III
Overvoltage category	III
Design type	Device suited for use with equipment of safety classes I and II



Ambient conditions and protection classification	
Degree of protection of housing to IEC EN 60529 Room automation station	IP20
Climatic ambient conditions Transport (packaged for transport) as per IEC EN 60721-3-2	Class 2K3 Temperature -25...70 °C Air humidity 5...95% (non-condensing)
Operation as per IEC/EN 60721-3-3	Class 3K5 Temperature -5...50 °C Air humidity 5...95% (non-condensing)
Mechanical ambient conditions Transport as per IEC/EN 60721-3-2 Operation as per IEC/EN 60721-3-3	Class 2M2 Class 3M2

Standards, directives and approvals	
Product standard	IEC/EN 60730-1 Automatic electronic controls for household and similar use
EU conformity (CE)	A6V11791489
RCM conformity	A6V11791498
EAC conformity	Eurasian conformity
UL Approbation Federal Communications Commission	UL as per UL916, <a href="http://ul.com/database">http://ul.com/database</a> cUL as per CSA – C22.2 No. 205 FCC CFR 47 Part 15 Class B
ICES003	CAN ICES-3 (B)/NMB-3(B)
Environmental compatibility	The product environmental declaration (A6V11805930*) contains data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal).

\* The documents can be downloaded from <http://siemens.com/bt/download>.

### FCC regulations

**Modification of this device to receive cellular radio telephone service signals is prohibited under FCC rules and federal law.**

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

Reorient or relocate the receiving antenna.

Increase the separation between the equipment and receiver.

Connect the equipment into an outlet on a circuit different from that to which the receiver is connected. Consult the dealer or an experienced radio/TV technician for help.

Changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.

### Statement

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.


### General

---

General Information	
Color	Light gray
Dimensions	L × W × H = 137 × 143 × 82 mm
Weight	Net weight: 666.0 g Gross weight: 891.8 g


Connection terminals

DXR1.E10PL-112 and DXR1.E10PL-113

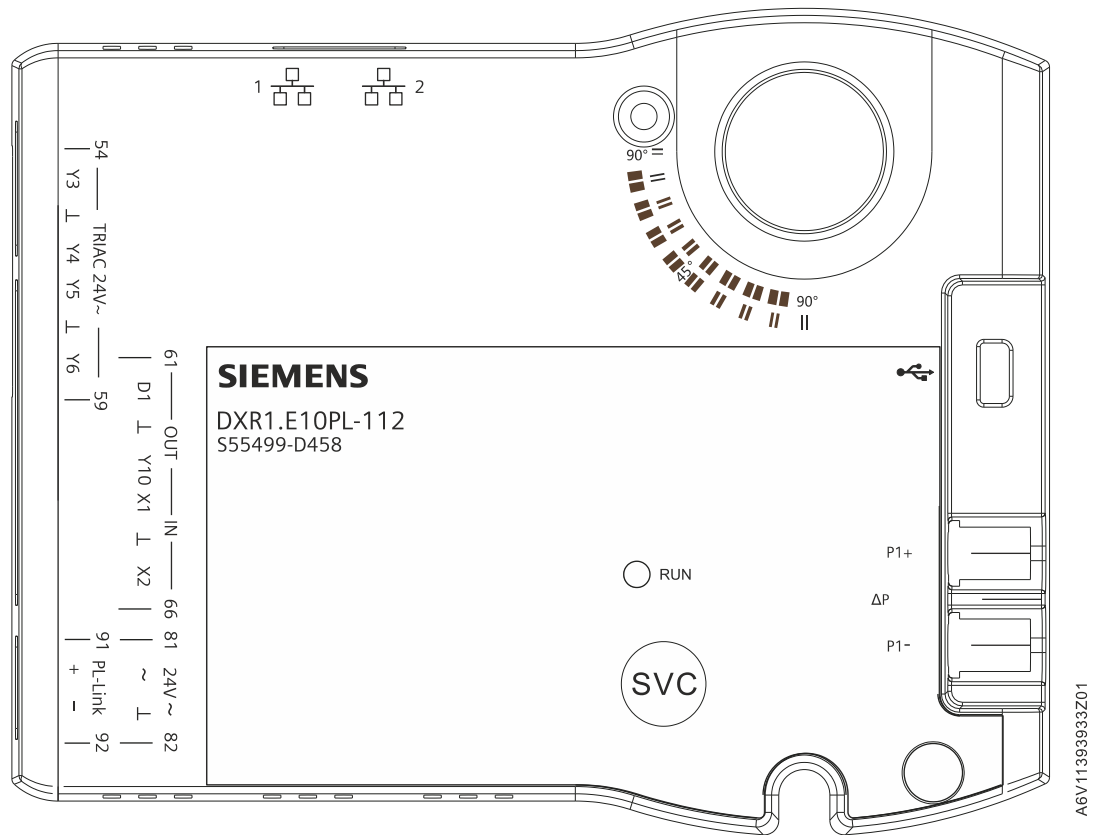

Pin	Description	Terminal
1, 2	IP connection	
USB	USB interface	
81, 82 power 24 V~	Power supply AC 24 V	V~
	System neutral (must always be grounded at the transformer)	
91, 92	KNX PL-Link	+, -
61	Digital input	DI
62, 63 outputs	DC 0...10 V output	Y10
64...66 inputs	Universal inputs	X1, X2
54...56 Triac outputs	Digital output AC 24 V	Y3, Y4
57...59 Triac outputs	Digital output AC 24 V	Y5, Y6
ΔP differential pressure detector	Connected to the higher pressure	P1+
	Connected to the lower pressure	P1-
Service	Service button	SVC
Display	Operation LED	RUN

## Dimensions

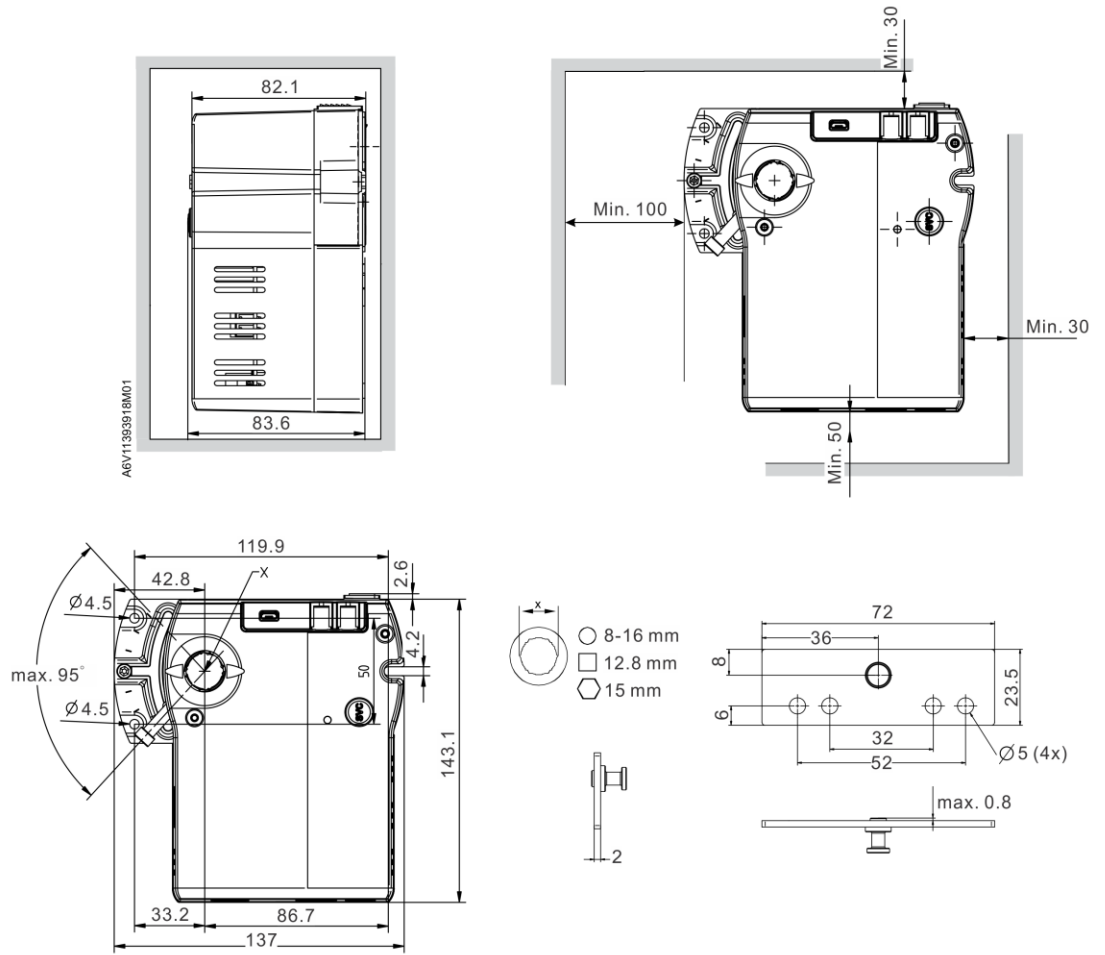

Dimensions in mm