

Self-learning Room Temperature Controller

RAV11...

with analogue 24-hour or weekly time switch



Mains-independent room temperature controller featuring straightforward operation.

Self-learning two-position controller providing PID control (patented).

Freely selectable switching times.

Use

Room temperature control in:

- Single-family and holiday houses
- Apartments and office spaces
- Individual rooms and consulting rooms
- Commercially used spaces

For the control of the following pieces of equipment:

- Solenoid valves of instantaneous water heaters
 - Solenoid valves of atmospheric gas burners
 - Forced draught gas and oil burners
 - Circulating pumps in heating systems
 - Electric direct heating
 - Fans of electric storage heaters
 - Zone valves (normally closed))
-

Functions

- PID control
- Self-learning or selectable switching cycle
- Freely adjustable 24-hour mode
- Freely adjustable weekly mode with weekly time switch
- Frost protection function
- Minimum limitation of set point

Type summary

Room temperature controller, DC 3 V battery powered without time switch	RAV11
Room temperature controller, DC 3 V battery powered with analogue 24-hour time switch	RAV11.1
Room temperature controller, DC 3 V battery powered with analogue weekly time switch	RAV11.7
Analogue 24-hour time switch	AUZ3.1
Analogue weekly time switch	AUZ3.7

Ordering

When ordering, please give type reference according to "Type summary".


Delivery

The unit is supplied with batteries.





Mechanical design

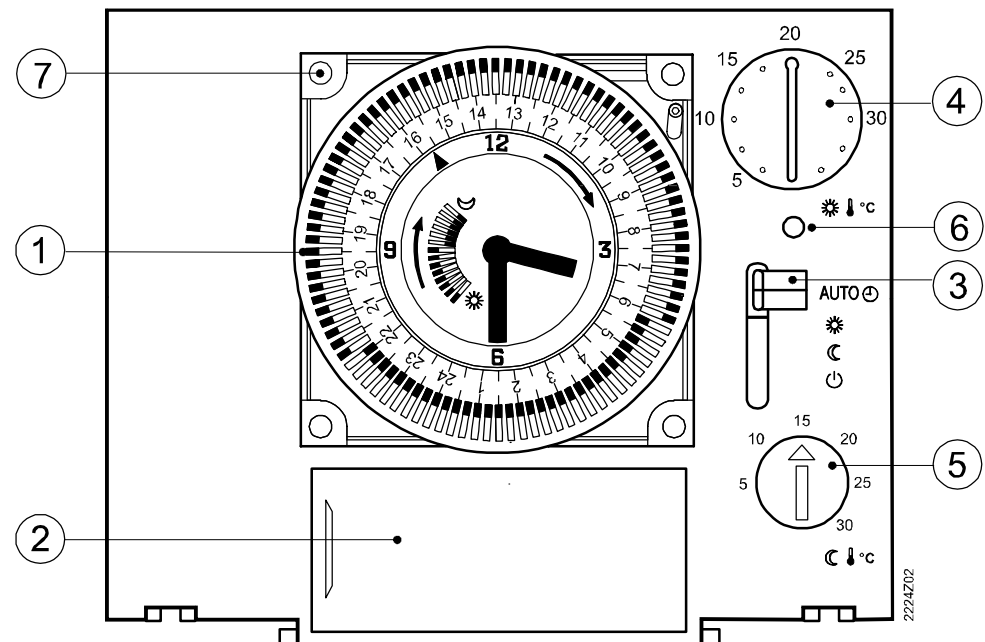

Plastic casing with analogue 24-hour or weekly time switch, easily accessible operating elements and removable cover. The removable battery compartment allows straightforward replacement of the two 1.5 V alkaline batteries. The base plate can be fitted to all commercially available recessed conduit boxes or directly on the wall and can then be wired before fitting the controller to it. The casing accommodates the electronics with the DIP switch. The potential-free changeover contact and the connection terminals are located on the base plate.

Operating elements




- | | |
|---|--|
| <p>① Analogue time switch</p> <ul style="list-style-type: none"> ☀ Tappets tilted outward for normal temperature ☾ Tappets tilted inward for economy temperature | <ul style="list-style-type: none"> ☀ Continuous normal temperature ☾ Continuous economy temperature ⏻ Standby with frost protection |
| <p>② Battery compartment</p> <p>Two alkaline batteries 1.5 V (AA)</p> | <p>④ Setting knob for normal temperature</p> |
| <p>③ Operating mode selector</p> <p>AUTO ⏻ Heating periods according to tappet settings on time switch</p> | <p>⑤ Setting knob for economy temperature</p> <p>⑥ LED for low battery indication</p> <p>⑦ Position for time switch</p> |

Operating modes	AUTO 	Heating periods according to tappet settings on time switch
		Continuous normal temperature
		Continuous economy temperature
		Standby with frost protection

Set points	Factory settings	Setting range
	20 °C	5...30 °C
	15 °C	5...30 °C

Technical features

DIP-Switch

	1	2	3	4
Self learning	<input type="checkbox"/>	<input type="checkbox"/>		
PID 12	<input type="checkbox"/>	<input type="checkbox"/>		
PID 6	<input type="checkbox"/>	<input type="checkbox"/>		
2-Pt 	<input type="checkbox"/>	<input type="checkbox"/>		

2224Z01

Control

The RAV11... is a two-position controller providing PID control. The room temperature is controlled through the cyclic switching of a regulating unit.

Self-learning mode

The controller is supplied with an active self-learning mode, which enables it to automatically adapt to the controlled system (type of building construction, type of radiators, size of rooms, etc.). After a certain learning period, the controller optimises its parameters and then operates in the mode it has learned.

In exceptional cases, where the self-learning mode may not be adequate, it is possible to choose between PID 12, PID 6 or 2-Pt mode:

PID 12 mode

Switching cycle of 12 min for normal or slow controlled systems (e.g. massive building structures, large spaces, cast-iron radiators, oil burners).



PID 6 mode

Switching cycle of 6 min for fast controlled systems (e.g. light building structures, small spaces, plate radiators or convectors, gas burners).

2-Pt mode

Pure two-position control with a switching differential of 0.5 °C (± 0.25 °C) for very difficult controlled systems with considerable outside temperature variations.

Setting knobs

	
5...30 °C	5...30 °C

Analogue time switches

The unit has an opening for fitting a plug-in type switch.


If desired, the time switch fitted can be replaced by another. The electrical connections to the controller are established via a terminal strip so that no wiring is required. *The time switches can only be mounted in one position.*

The analogue time switches are equipped with a quartz clock. The switching dial is equipped with tappets that can be tilted. The heating periods are entered by tilting the tappets within the required period of time:

- Tappets tilted outward: Normal temperature ☀
- Tappets tilted inward: Economy temperature ☾

24-hour time switch	Weekly time switch
The 24-hour time switch has a 24-hour switching dial. It carries 96 tappets, which means four tappets per hour, giving a resolution of 15 minutes. The shortest possible heating period also is 15 minutes.	The weekly time switch has a 7-day switching dial. It carries 84 pairs of tappets, which means 12 pairs of tappets or 24 individual tappets per day. The resolution is thus one hour. However, since – for mechanical reasons – at least two tappets need to be tilted together to set one heating period, the shortest possible heating period is two hours.

Calibration of detector

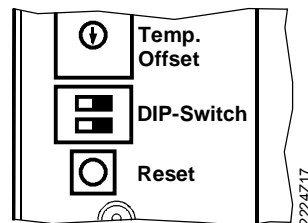




If the measured room temperature does not agree with the temperature set on the knob, the temperature detector can be recalibrated.

This can be done by adjusting a potentiometer that is located on the rear of the unit. First, the unit must be removed from the socket.

The possible settings on the potentiometer are:



 (°C)	 (°C)	 Pos.	
22.00	20.00	8	
21.75	20.00	7	
21.50	20.00	6	
21.25	20.00	5	
21.00	20.00	4	
20.75	20.00	3	
20.50	20.00	2	
20.25	20.00	1	
20.00	20.00	0	<= Factory setting
19.75	20.00	F	
19.50	20.00	E	
19.25	20.00	D	
19.00	20.00	C	
18.75	20.00	B	
18.50	20.00	A	
18.25	20.00	9	

After the corrections are made, the new setting must be confirmed by pressing the reset button. **Otherwise the previous settings are still active!** After the reset the controller can be remounted to the socket.

Disposal



The device is considered an electronic device for disposal in terms of the European Directive 2012/19/EU and may not be disposed of as domestic garbage.

- Dispose of the device through channels provided for this purpose.
- Comply with all local and currently applicable laws and regulations.
- Dispose of empty batteries in designated collection points.

	⚠ WARNING
	Risk of explosion due to fire or short-circuit, even if the batteries are empty Risk of injuries from by flying parts <ul style="list-style-type: none"> • Do not allow the batteries to come into contact with water. • Do not charge the batteries. • Do not damage or destroy the batteries. • Do not heat the batteries to more than 85 °C.

	⚠ WARNING
	Electrolyte leakage Chemical burns <ul style="list-style-type: none"> • Only grasp damaged batteries using suitable protective gloves. • If electrolyte comes into contact with eyes, immediately rinse eyes with plenty of water. Consult a doctor.

Observe the following:

- Only replace batteries with batteries of the same type and from the same manufacturer.
- Observe the polarities (+/-).
- The batteries must be new and free from damage.
- Do not mixed new batteries with used batteries.
- Store, transport, and dispose of the batteries in accordance with local regulations, guidelines, and laws. Also observe information from the battery manufacturer.

Technical Data

Operating voltage	DC 3 V
Rated impulse voltage	4000V
Batteries (alkaline AA)	2 x 1.5 V
Battery life (approx.)	2.5 years
Backup for battery change	1 min max.
Automation action	100,000 cycles
Resolution of analogue time switches	24-hour time switch Weekly time switch



No internal fuse.

External preliminary protection with max. C 10 A circuit breaker in the supply lines required under all circumstances.

Relay output

Switching voltage	AC 24...250 V
Rated current	8 (3.5) A

Standards

EU Conformity (CE)	CE1T2224xx *)
RCM Conformity	CE1T2224en_C1 *)

Environment

Perm. ambient temperature	Operation	3...35 °C
	Storage	-25...+60 °C
Perm. ambient humidity	DIN 40040	G

Measuring element NTC 68 k Ω at 25 °C	Measuring range	0...40 °C
	Time constant	2 min max.
Set point setting range	Normal temperature	3...29 °C
	Economy temperature	3...29 °C
Set point for frost protection	5 °C	

Eco design and labelling directives

Based on EU Regulation 813/2013 (Eco design directive) and 811/2013 (Labelling directive) concerning space heaters, combination heaters, the following classes apply:

- Application with On/Off operation of a heater Class I value 1%
- PWM (TPI) room thermostat, for use with On/Off output heaters Class IV value 2%

Protection

Degree of protection	IP30 (EN 60529)
Insulation class	II (EN 60730-1)
Pollution degree	2
Disconnection means	Type 1B

General data


Weight	0.2 kg
Color	White, RAL9003

*) The documents can be downloaded from <http://siemens.com/bt/download>.

Notes

Engineering

- The room temperature controller should be fitted in the main living room.
- The place of installation should be chosen so that the sensor can capture the room temperature as accurately as possible, without being affected by direct solar radiation or other heating or cooling sources.
- Mounting height is approx. 1.5 m above the floor.
- The unit can be fitted to most commercially available recessed conduit boxes or directly on the wall.

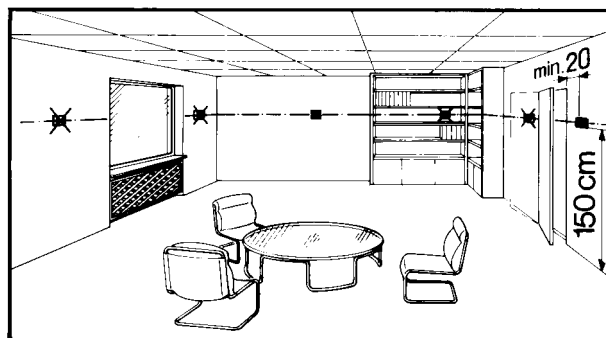

Fitting and installation

When installing the room temperature controller, the base plate must first be fitted and wired. Then, the unit is engaged at the top, swung downward and secured with two screws.

For more detailed information, please refer to the installation instructions supplied with the controller.

For the electrical installation, the local safety regulations and standards must be complied with.



Warning!

No internal line protection for supply lines to external consumers.


Risk of fire and injury due to short-circuits!

- Adapt the line diameters as per local regulations to the rated value of the installed overcurrent protection device.
- The power supply lines must have an external circuit breaker with a rated current of no more than 10 A.

Commissioning


- The battery transit tab, which prevents inadvertent operation of the unit during transport and storage, must be removed from the batteries.
- The control characteristics can be changed with the help of the DIP switches located at the rear of the unit. For detailed information, please refer to the commissioning instructions.
- If the reference room is equipped with thermostatic radiator valves, they must be set to their fully open position.
- If the measured room temperature does not agree with the set room temperature on the setting knob, the detector should be recalibrated (please refer to "Calibration of detector").

Connection diagram

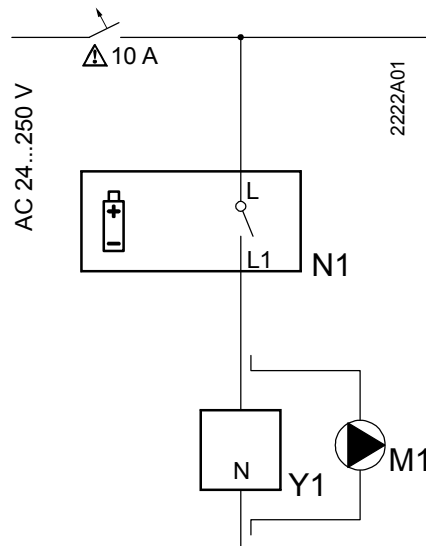


L	Live, AC 24...250 V	M1	Circulating pump
L1	N.O. contact, AC 24...250 V / 8 (3.5) A	N1	RAV11.. controller
N	Zero	Y1	Regulating unit


Application examples

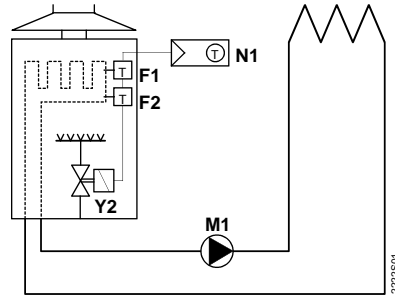

Instantaneous water heater

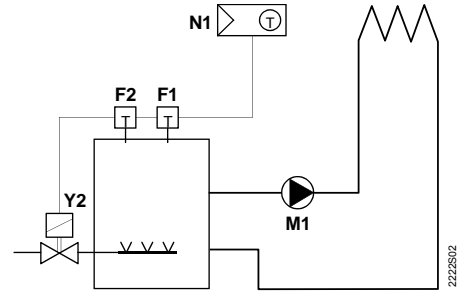



Atmospheric gas burner

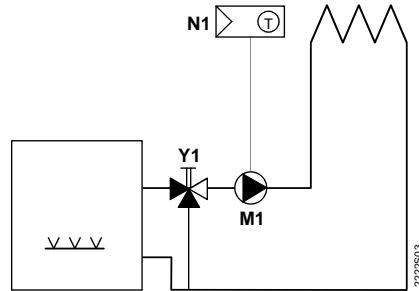

Circulating pump with pre-control by manual mixing valve

F1	Thermal reset limit thermostat	N1	RAV11.. room temperature controller
F2	Manual reset safety limit thermostat	Y1	Manually operated three-port valve
M1	Circulating pump	Y2	Solenoid valve

Dimensions

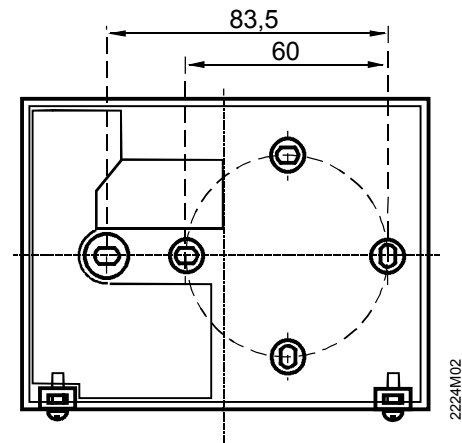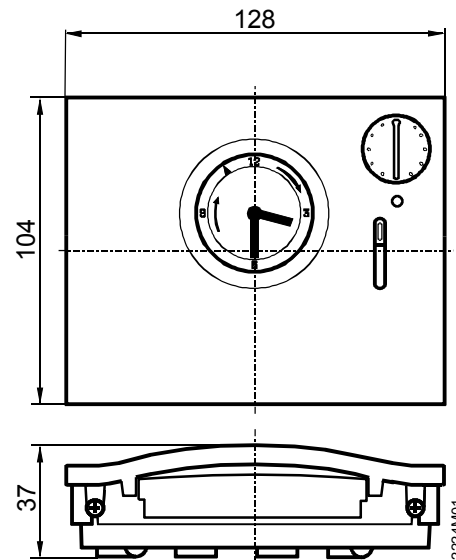

Issued by
Siemens Switzerland Ltd.
Building Technologies Division
International Headquarters
Gubelstrasse 22
CH-6300 Zug
Tel. +41 58-724 24 24
www.siemens.com/buildingtechnologies

© Siemens Switzerland Ltd, 1999 - 2017
Technical specifications and availability subject to change without notice.